

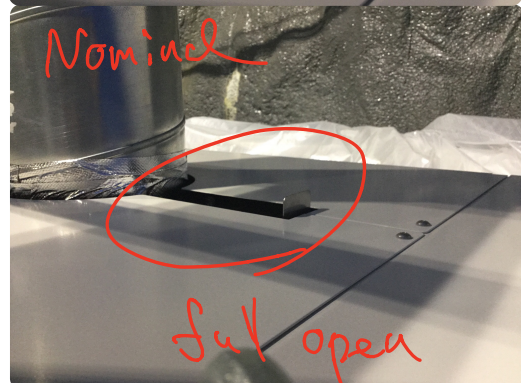


PSL backyard, Air Conditioner

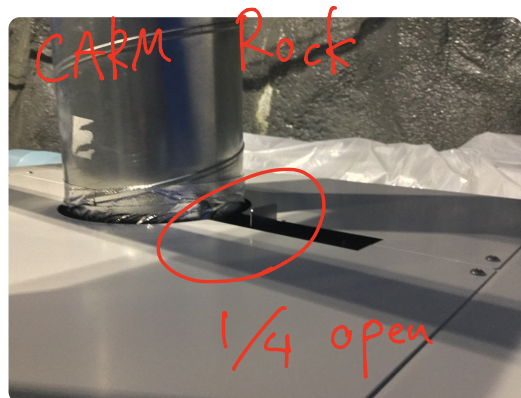


- nominal
 - ✓ Both On
- CARM Lock
 - ✓ AC1 on, AC2 off
 - ✓ Shutter of AC1 $\frac{1}{4}$ open

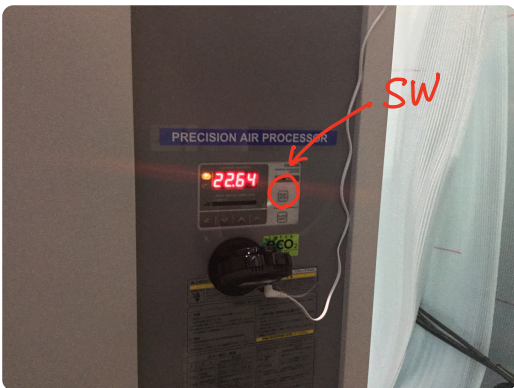

PSL KOACH

SW is at the entrance of the PSL

- Nominal : on
- CARM Lock : off

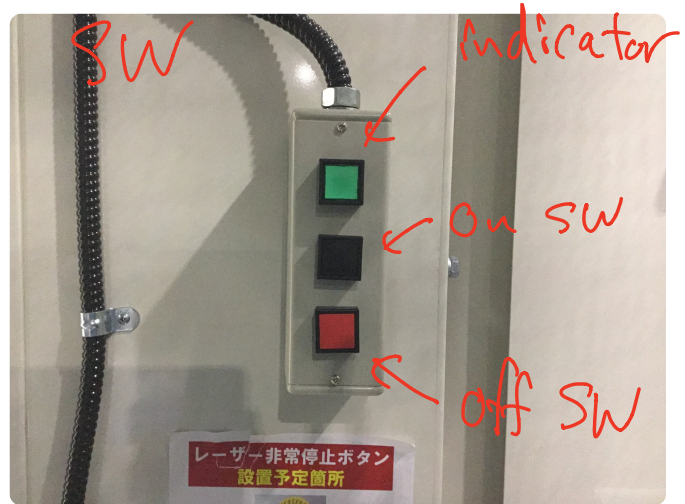

PSL FFU

Nominal : on, CARM Lock : off.


- Turn on/off by the circuit breaker on the pillar of the clean booth at the front of PSL room.




FFU around the MC, PR, BS area


CARM Lock: All off

Nominal: As follows.

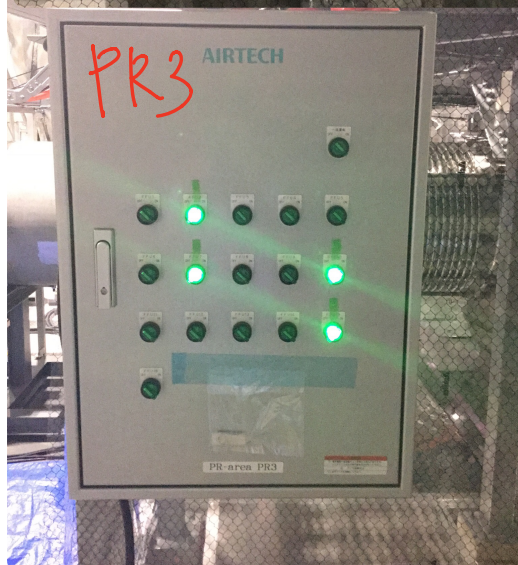



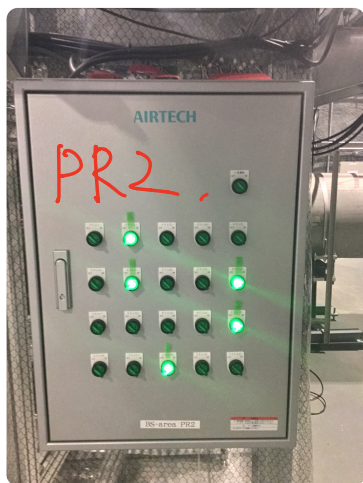


- FFU for the preparation area of PR area
 - Nominal: On, CARM Lock: off
 - Unplug the power supply to turn it off

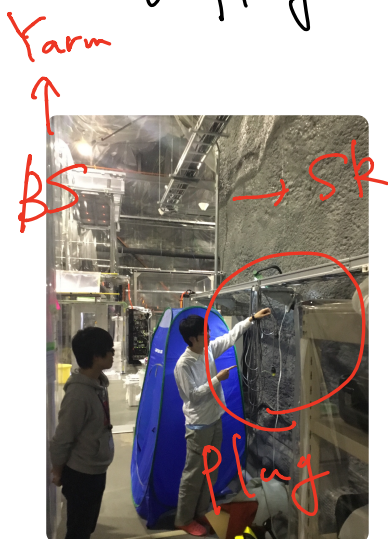


Air Compressor behind the PR3 chamber.

- ✓ Nominal : on , CARM Lock : off.
- ✓ Procedure to turn off : Close three valves , SW1 off, SW2 off
to turn on : opposite Way

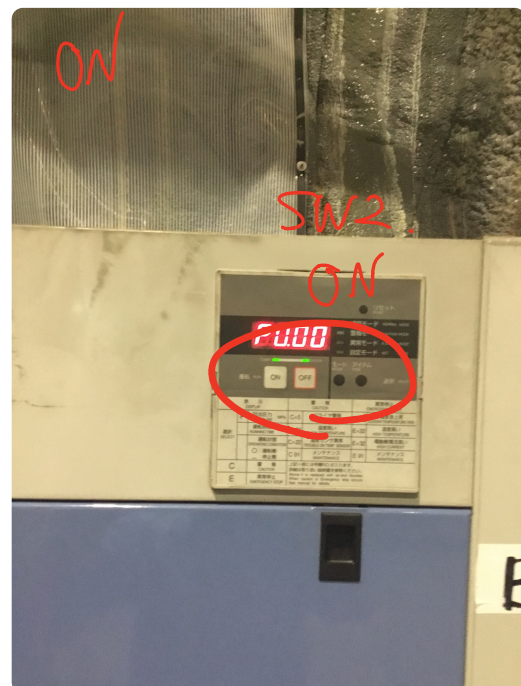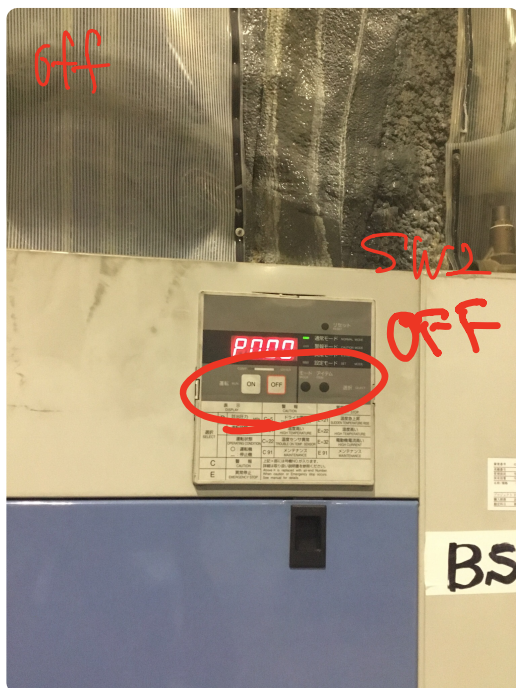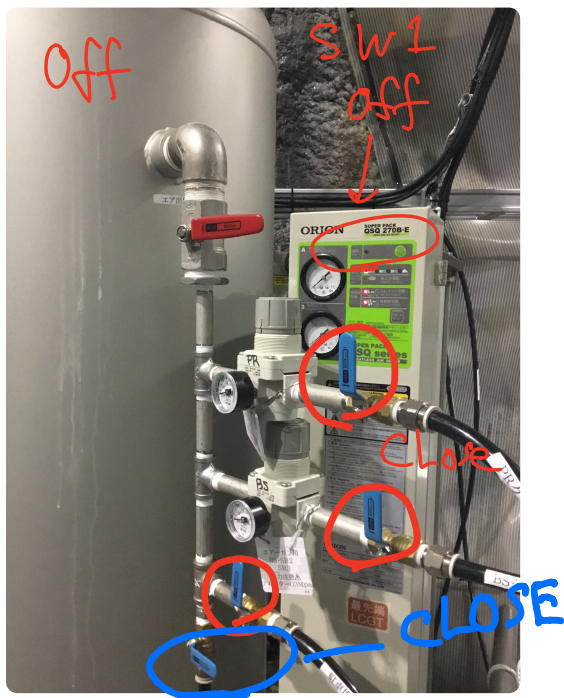


Air Conditioner around Center Area.

✓ MC area,

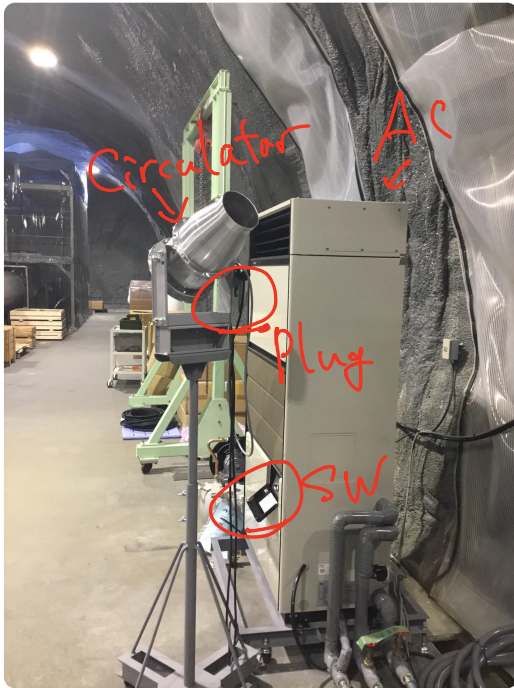

Nominal: AC, Circulator on
CAKM Lock: AC, Circulator off

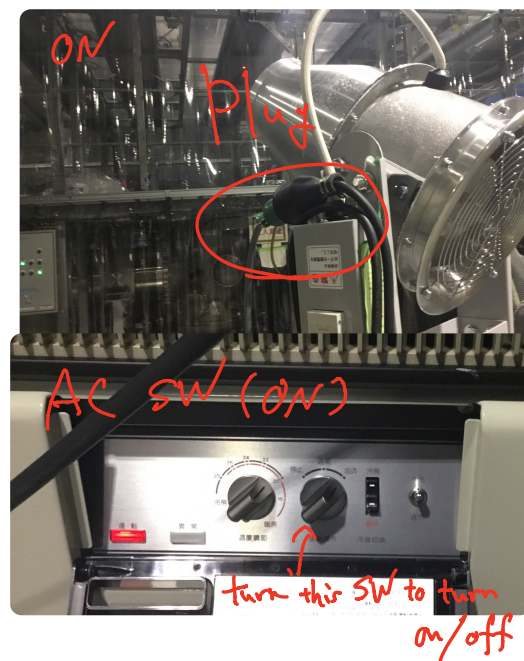

SK area



Nominal: On
CAKM Lock: On